


Personal Service Settings Cleaning Instruments

All instruments must be cleaned before disinfection or sterilization.

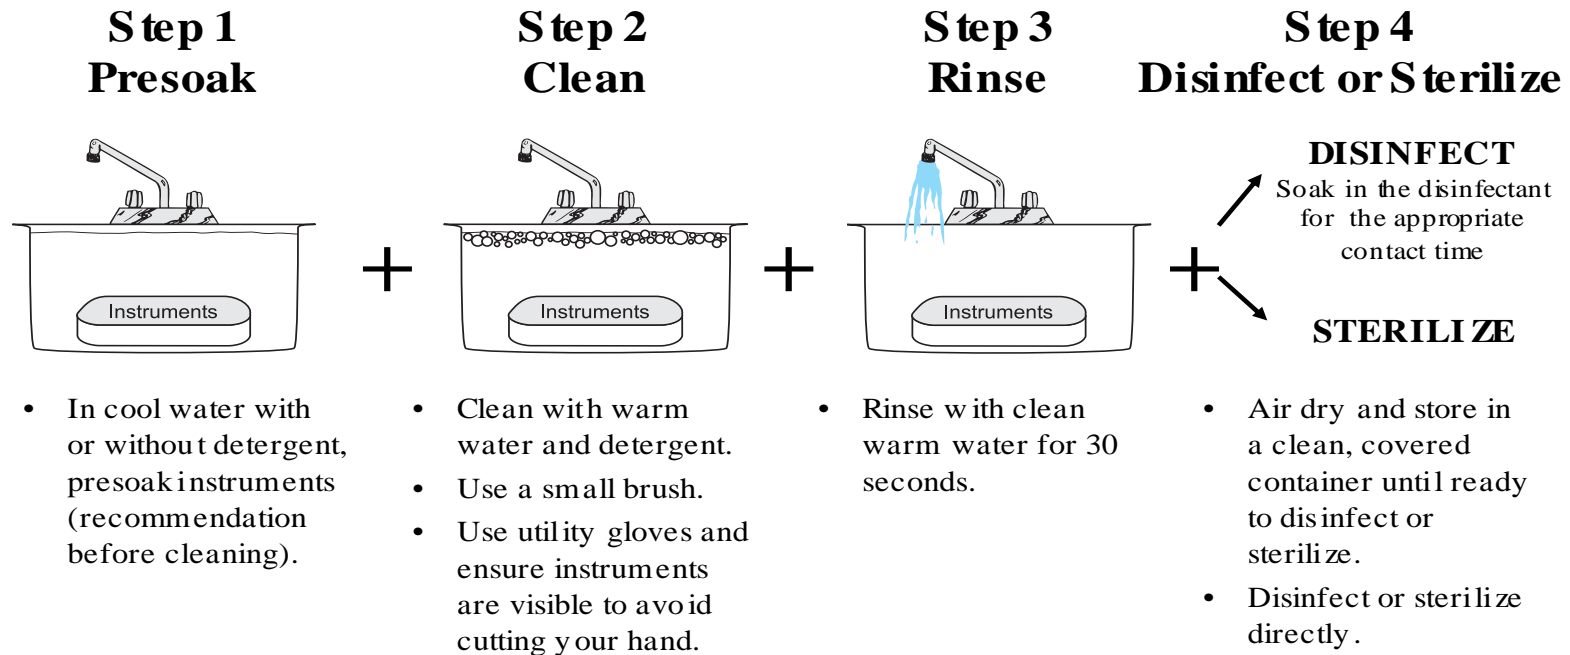

Disinfectants will not work properly if instruments are not cleaned first

January 2009